



ಬೆಂಗಳೂರು ವಿದ್ಯುತ್ ಸರಬರಾಜು ಕಂಪನಿ ನಿಯಮಿತ

(ಕರ್ನಾಟಕ ಸರ್ಕಾರದ ಸಂಪೂರ್ಣ ಸ್ವಾಮ್ಯಕ್ಕೆ ಒಳಪಟ್ಟಿದೆ)

ಸಂಖ್ಯೆ:- ಬಿ-18/ಮುಪ್ರವ್ಯ(ಕಾ)/ಉ.ಪ್ರ.ವ್ಯ-3/ F-402(99)/13-14/ 10169
ಲಗತ್ತು: 1

ನಿಗಮ ಕಾರ್ಯಾಲಯ,
ಬಿ.ವಿ.ಕಂ., ಕೆ.ಆರ್.ವೃತ್ತ,
ಬೆಂಗಳೂರು.

21 FEB 2014

ಮುಖ್ಯ ಇಂಜಿನಿಯರ್(ವಿ),
ಯೋಜನೆ ಮತ್ತು ಸಮನ್ವಯ,
ಕೆ.ಪಿ.ಪ್ರ.ನಿ.ನಿ,
ಬೆಂಗಳೂರು.

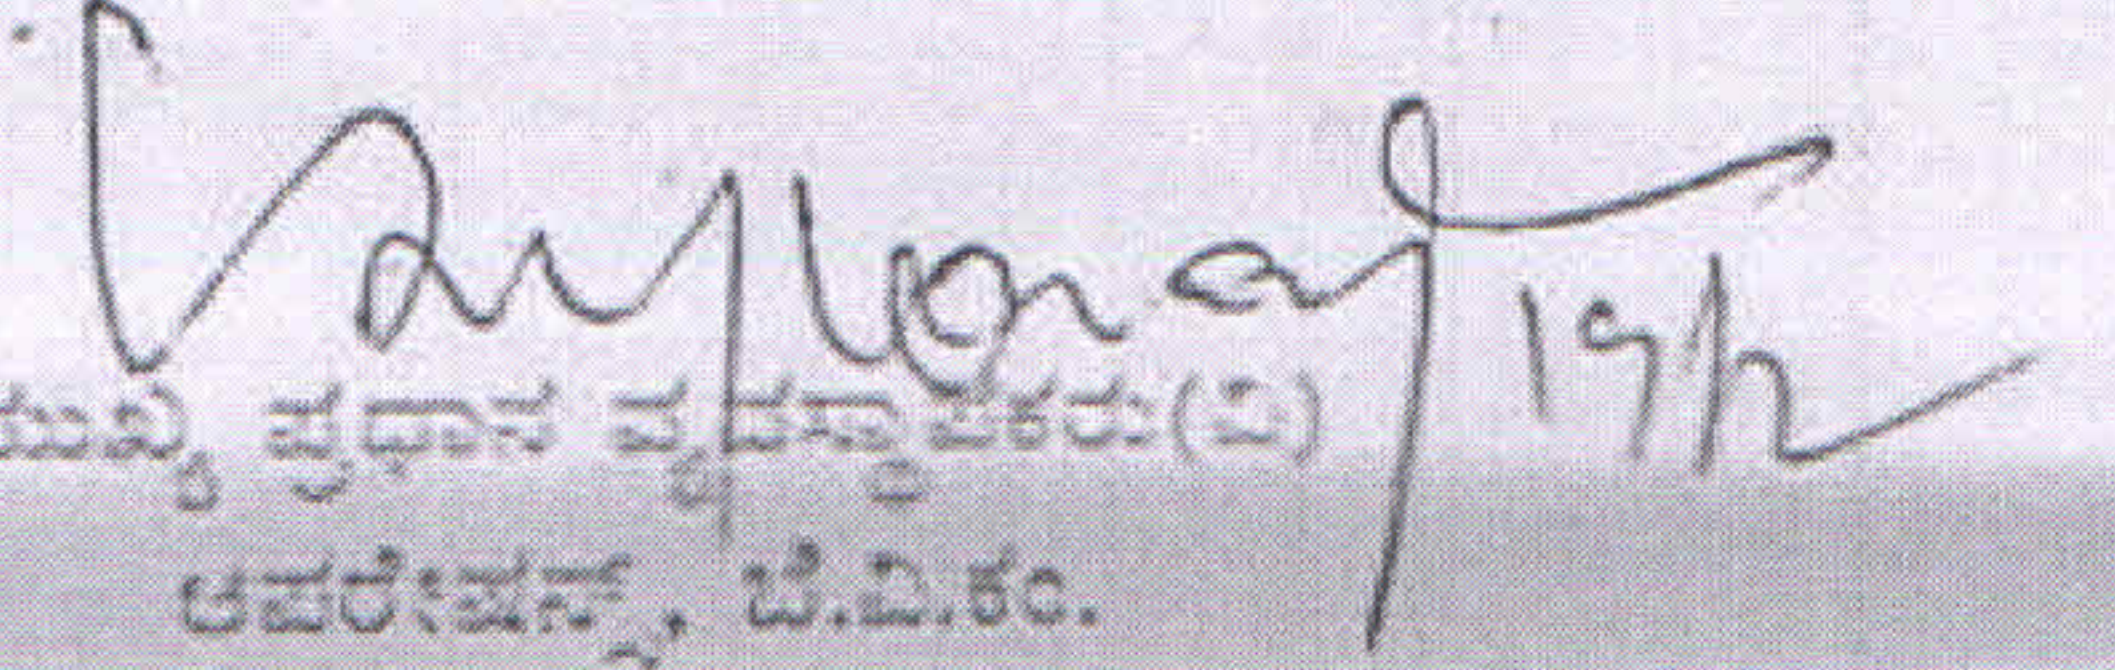
ಮಾನ್ಯರೇ,

ವಿಷಯ:- ಇಂದಿರಾನಗರ ವಿಭಾಗದ, E-4 ಉಪ ವಿಭಾಗ ವ್ಯಾಪ್ತಿಯ ಹೂಡಿ ಗ್ರಾಮದ ವೈಟ್‌ಫೀಲ್ಡ್ ಮುಖ್ಯ ರಸ್ತೆ ಸ. ನಂ: 28/2 ರಲ್ಲಿ ಮೆ|| ಯುನೈಟೆಡ್ ಆಕ್ಸಿಜನ್ ಕಂಪನಿ ಪ್ರೈ (ಲಿ) ರವರು ನಿರ್ಮಿಸಲುದ್ದೇಶಿಸಿರುವ ಗೃಹ ವಸತಿ ಕಟ್ಟಡಕ್ಕೆ ಎಲ್.ಟಿ ಆಧಾರದ ಮೇಲೆ ಒಟ್ಟು 3229 ಕೆ.ವಿ.ಎ ವಿದ್ಯುತ್ ಸಂಪರ್ಕವನ್ನು ನೀಡುವ ಸಂಬಂಧ ನಿರಾಕ್ಷೇಪ್ಪಣಾ ಪತ್ರವನ್ನು ನೀಡಲು ಅನುಮೋದನೆ ಕೋರಿ ಬೆಂಗಳೂರು ಮಹಾನಗರ ಕ್ಷೇತ್ರವಲಯದ ಮುಖ್ಯ ಇಂಜಿನಿಯರ್(ವಿ)ರವರು ಸಲ್ಲಿಸಿರುವ ಪ್ರಸ್ತಾವನೆಯ ಕುರಿತು.

- ಉಲ್ಲೇಖ:- 1. ಪತ್ರ ಸಂ. CEE/BMAZ/SEE(O)/AE/6769-72 dated 08-01-2014.
2. Proceedings of 25th BESCOM TCM held on 14.02.14.

ಮೇಲ್ಕಂಡ ವಿಷಯಕ್ಕೆ ಸಂಬಂಧಿಸಿದಂತೆ, ಇಂದಿರಾನಗರ ವಿಭಾಗದ E-4 ಉಪ ವಿಭಾಗ ವ್ಯಾಪ್ತಿಯ ಹೂಡಿ ಗ್ರಾಮದ ವೈಟ್‌ಫೀಲ್ಡ್ ಮುಖ್ಯ ರಸ್ತೆ ಸ.ನಂ:28/2 ರಲ್ಲಿ ಮೆ|| ಯುನೈಟೆಡ್ ಆಕ್ಸಿಜನ್ ಕಂಪನಿ ಪ್ರೈ(ಲಿ) ರವರು ನಿರ್ಮಿಸಲುದ್ದೇಶಿಸಿರುವ ಗೃಹ ವಸತಿ ಕಟ್ಟಡಕ್ಕೆ ಎಲ್.ಟಿ ಆಧಾರದ ಮೇಲೆ ಒಟ್ಟು 3229 ಕೆ.ವಿ.ಎ ವಿದ್ಯುತ್ ಸಂಪರ್ಕವನ್ನು ನೀಡುವ ಸಂಬಂಧ ನಿರಾಕ್ಷೇಪ್ಪಣಾ ಪತ್ರವನ್ನು ನೀಡಲು ಅನುಮೋದನೆ ಕೋರಿ ಬೆಂಗಳೂರು ಮಹಾನಗರ ಕ್ಷೇತ್ರವಲಯದ ಮುಖ್ಯ ಇಂಜಿನಿಯರ್(ವಿ)ರವರು ಸಲ್ಲಿಸಿರುವ ಪ್ರಸ್ತಾವನೆಯ ಪ್ರಸ್ತಾವನೆಗೆ ಸಂಬಂಧಿಸಿದ ಮಾಹಿತಿಗಳನ್ನು ನಿಗದಿತ ನಮೂನೆಯಲ್ಲಿ ಲಗತ್ತಿಸಿ ಸಲ್ಲಿಸಲಾಗಿದ್ದು, ಪ್ರಸ್ತುತ ಪ್ರಸ್ತಾವನೆಯನ್ನು ಕೆ.ಪಿ.ಟಿ.ಸಿ.ಎಲ್. ತಾಂತ್ರಿಕ ಸಮನ್ವಯ ಸಮಿತಿಯಲ್ಲಿ ಮಂಡಿಸಿ, ಅನುಮೋದನೆ ನೀಡಲು ಕೋರಲಾಗಿದೆ.

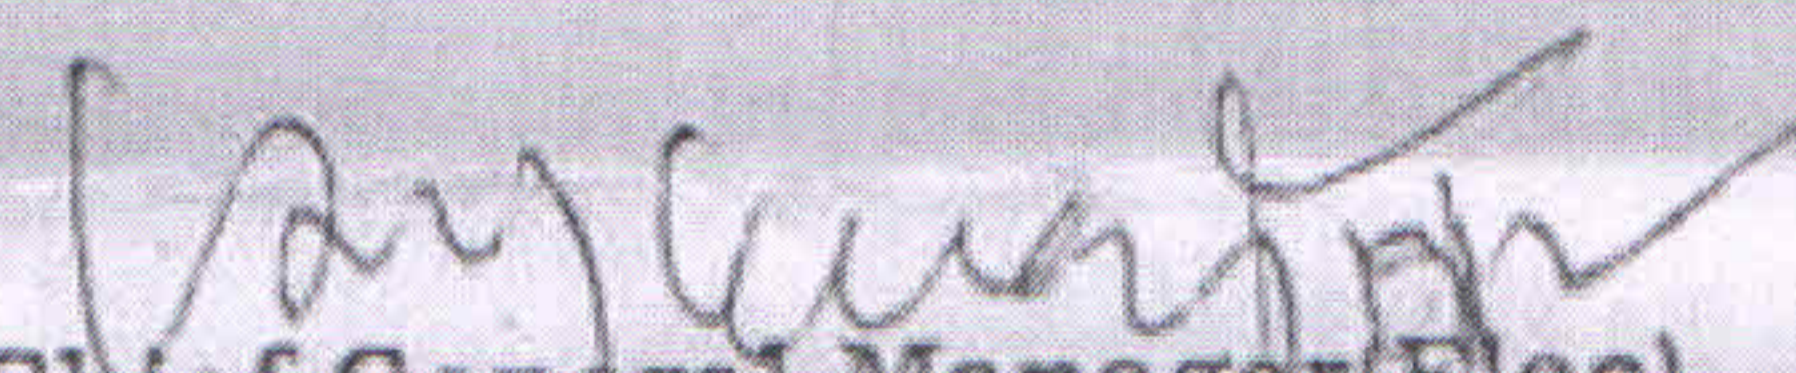
ತಮ್ಮ ವಿಶ್ವಾಸಿ,


ಮುಖ್ಯ ಪ್ರಧಾನ ವ್ಯವಸ್ಥಾಪಕರು(ವಿ)
ಆಪರೇಷನ್ಸ್, ಬಿ.ವಿ.ಕಂ.

Format: Proposal for issuing of NOC for arranging power supply to an extent of 3229 KVA to the proposed residential apartment in favour of M/s United Oxygen Co Pvt Ltd., at Sy No 28/2, whitefield Main Road, Hoody, Bangalore, E-4 Sub-Division of Indira Nagar Division.

Sl. No	Particulars		
1	Name & Address of the Applicant		M/s United Oxygen Co. Pvt. Ltd., #10, 4 th Floor, Pride Elite, Museum Road, Bangalore-560001.
2	Location		Sy No 28/2, Whitefield Main Road, Hoody, Bangalore-560048, E-4 Sub-Division of Indira Nagar Division.
3	Type	Residential Apartment having 2 Towers, each Tower with LBF+UBF+GF+20UF's	
	Site Area	10 Acres 21 Guntas	
4	Requisition load details		
	a) Requisition load	3229 KVA	
	b) Voltage class proposed for APS	433 V	
	c) Probable date of availing P/S	Not mentioned	
5	Proposed regular source station details		
	a) Station name	66/11 KV Brigade Metropolies MUSS	
	b) Station details	As fallows	
	Voltage Class	Installed capacity in MVA	Peak load in MW
	66/11 KV	1 X 20	11.5 (13.53 MVA)
			Remarks Station loaded 67.64%
	c) Conductor type and Peak load	New feeder using 3 X 400 Sq mm UG Cable.	
6	Proposed alternate source station details		
	a) Station name	220/66/11 KV Hoody MUSS	
	b) Station details	As fallows	
	Voltage Class in KV	Installed capacity	Peak load in MW
	220/66/11	2 X 31.5 MVA	51 (60 MVA)
			Remarks Station loading is 95.24 %

	c) Conductor type and Peak load	New feeder using 3 X 400 Sq mm UG Cable
7	BESCOM Proposal	
<p>CEE, BMAZ proposes the following works for issuing of NOC for arranging power supply to an extent of 3229 KVA to the proposed residential apartment having 2 Towers with LBF+UBF+GF+20UF's in favour of M/s United Oxygen Co Pvt. Ltd., at Sy No 28/2, in Whitefield Main road, Hoody, Bangalore, E-4 Sub-Division of Indira Nagar Division, under self-execution.</p>		
Regular source:		
<ul style="list-style-type: none"> • It is proposed New Independent feeder by providing matching breaker in the 66/11 KV Brigade Metropolis Station and drawing 11 KV about 1.5 KM distance by using 3 X 400 Sq mm XLPE HT UG cable from 66/11 KV Brigade Metropolis Station to consumer premises with 1 no of OD. 		
Alternate source:		
<ul style="list-style-type: none"> • It is proposed New Independent feeder by providing matching breaker in the 220/66/11 KV Hoody MUSS and drawing 11 KV about 1.6 KM distance by using 3 X 400 Sq mm XLPE HT UG cable from 220/66/11 KV Hoody MUSS to consumer premises with 1 no of OD. 		


 Chief General Manager (Elec)
 Operations, BESCOM